

EFFICIENT ENERGY MANAGEMENT IN MICROGRIDS UTILIZING RENEWABLE ENERGY SOURCES

#1Mr.PADAKANTI BALAKISHAN, Assistant Professor
#2 GAJAVELLI SHIVA GANESH, #3 GUNJAPADUGU AKSHAYA ,
#4 BANDARI RAKSHITHA,

Department of Electrical and Electronics Engineering,
Sree Chaitanya Institute Of Technological Sciences, Karimnagar.

ABSTRACT- The major goal of this project is to create a power management system that governs the energy requirements and power transmission of a fully integrated green energy system, with a focus on solar and wind power. Control systems and highly reliable storage systems are essential to ensure that the entire system runs smoothly and consistently. The frequency and voltage of the line-side converter can be controlled by indirect vector control with droop characteristics. Fluctuations in frequency result from changes in the battery's energy status, particularly during the charging and discharging operations. Despite the lack of wind energy, the system continues to function. An Intelligent Power Management System (IPMS) is designed to handle changes in power demand and supply by establishing a dependable control algorithm for the entire system and regulating unpredictable power. This allows for the testing of various power supply and power needs via a power system. Simulations have shown that the IPMS can reliably meet demand by utilizing batteries and intermittent renewable energy sources such as wind and solar power.

Keywords- Control system, IPMS, PV, Systems Power Energy.

1. .INTRODUCTION

In many isolated places of the world today, diesel engines are the only source of power. It is expensive and spreads quickly when using these energy sources. To alleviate these challenges and better meet people's requirements, we need to generate a lot of power in the area. The author has a separate PV setup with a self-contained windmill. However, a self-sufficient machine with a single energy source requires a significant amount of storage and PE components that work with it. This is typically required for converters that use solar electricity to charge and discharge batteries. Nevertheless, the due date It is more expensive and heavier due to its complex construction. Furthermore, converting in phases makes the system less efficient.

When two or more hybrid power sources are combined, the system becomes more reliable and does not require as much BES. Hybridization works best with both solar and wind energy. Action patterns that occur on a regular basis throughout the year are well documented. Say kind things. It has been presented independently by several different

writers. To maximize the benefits of this combination, use a hybrid solar and wind configuration. The permanent magnet synchronous generator is most commonly employed in small windmills. Even for more expensive machines, a PMSG can be built without gears. SCIG can produce machines at a lower cost than other firms since they do not have to limit the speed to achieve the MPPT. Some contributors also built SCIG engines and wind-solar hybrid systems. Furthermore, once speed control is established, a complete conversion is required. Many writers are writing on solar and self-sufficient applications. Wind power has been employed in industry, with one example being a dual power induction generator (DFIG). Low-power converters can be utilized to power the DFIG Variable Speed Process. This is an example of a microgrid renewable energy system (REGS) powered by wind and equipped with a solar-powered light source. Diode characteristics combined with a PV system that monitors high power points and includes numerous DC-DC converter inputs for conversion We examine at how effectively

the DC converter works and how many power sources may be used simultaneously.[3]

Other photovoltaic (PV)-based totally autonomous energy systems, such as PV solar arrays and batteries, are frequently used to regulate the power generated [6] from various energy sources and offer clients with consistent energy in the appropriate form. Three different DC-to-DC converters may have been utilized previously. This study demonstrates how to employ a remoted dc/dc 3-port converter (TPC) for PV to reduce the cost of the energy gadget while increasing its energy density [9]. A battery energy storage system (BESS) is added to the hybrid device to help keep energy levels stable as wind, sun, and freight change [10, 11].

A DC-DC enhance converter regulates the utilization of low-voltage PV and battery backups to extract the maximum energy from a solar PV array while also adjusting the output DC voltage. It accomplishes this by utilizing perturbation and statement high-voltage advantage converters. This minimizes the impacts of parasitic capacitance and partial shadowing at the PV source. Many distinct battery units can be linked together in series without necessarily being connected in series. This prevents problems like overcharging and deep draining, which reduce the battery's life.

The suggested manipulation methods are demonstrated using MATLAB/Simulink, and their overall performance is evaluated in real time when there are stable, unstable, linear, and nonlinear masses, as well as when the weather changes.[4] Because of its tiny size, the area of wind power that has received the greatest attention recently has been distributed generation employing small wind turbines (200 kW power plants). You can add extra power sources to your system as needed because they all connect to the same power line.

A lot of emphasis has been dedicated to the development of active and reactive power controls, as well as dump power controls. Consider how a stand-alone hybrid power system that combines both wind and solar energy works to increase system reliability and energy conversion efficiency. The results

demonstrated that the system could accurately adjust the flow of energy under various loads and weather conditions.

They also demonstrated that the amplitude and phase of the proposed hybrid system's AC output voltage were accurately adjusted. If Microgrids (MG) are the general concepts investigated in a number of studies [3], global energy consumption will have increased by more than 25% by 2040. Green energy sources, which are growing increasingly popular, are expected to account for approximately 40% of global energy consumption. The fundamental cause for the unreliability of green energy sources is a mismatch between supply and demand [2].

Energy is brought closer to its users by reimagining energy systems, energy storage, renewable energy sources, and distributed generation (DG). This energy is derived from renewable sources.[12] PV DC microgrids exhibit significant time variation and nonlinearity. As a result, classic dual voltage and current regulation systems based on PI[14] controllers will be unable to effectively restrict changes and effects of DC bus voltage, even if the system's dynamic response is increased. The voltage and frequency of the road facet converter are regulated by diagonal vector control in the Droop property [15].

It adjusts the frequency reference based on the battery's energy level and slows the rate at which it charges or discharges. This strategy remains effective even when there are no wind energy sources nearby. Every wind and solar energy block has a function called maximum power point tracking (MPPT) incorporated into its operation. There is no need for more electricity because the device's power source recharges the battery. For various conditions, a Simulink or MATLAB model is created.

2. TOPOLOGY STRUCTURE

Figure 1 shows a schematic drawing of the REGS device micro mesh that was provided. The approach is intended for areas that can accommodate the most people. 15 kW on average and 5 kW on average. With solar blocks, REGS can manage up to 15 kW of wind power. The incubator can operate at 20%

power, which is sufficient to power both power blocks for a day. If there aren't enough wind energy sources, the circuit breaker will protect the system, as seen in the image. The CC side RSC and LSC connect to the HV side of the solar system, which stores energy in batteries. The LSC controls both the cycle rate and the voltage of the machine. This is the wind energy absorption rotor that powers the DFIG. Mechanical power has a value based on

$$P_m = 0.5 C_p \pi r^2 \rho V_w^3 \quad (1)$$

Here, r and V_w represent the precise radius and speed of the wind that the wind machine is facing. The generator in the suggested configuration can generate 17 kW of power at a wind speed of 12 m/s. A current from outside the DFIG powers the stator and rotor. The DFIG clearance (P_{ag}) grade is related to not accounting for losses at the greatest wind speed. The unit's electrical power threat is assumed to be equal to the maximum power of the entry, which is an air gap. RSC delivers all of the magnetism power that a wind rotor requires when in operation. With the appropriate quantity of DFIG power, 15 kW of wind energy may be converted into electricity.

$$P_e = P_{ag} / (1 + |S_{pmax}|) \quad (2)$$

To connect the load and stator poles to the LSC, a zigzag transformer is employed. The LSC is also neutral for single-phase loads on the 415 volt side. The voltage on the LV side of the zigzag, V_{rmax} , is likewise selected. So, the transformer's HV coil, stator, and load voltage ratio of 415/125 V remain constant. The internal resistance R_{in} could be a direct current power source with a capacitor C_b . It's connected in series. The battery is also connected to an additional RB resistance, allowing it to relax on its own. The open cell voltage ($VOCC$) and DC voltage indicate how many cells are in the circuit. $NC = VDCM / 3p$. RC filters are utilized in the stator connection to reduce voltage waves and frequencies below the fundamental frequency. In addition, the switching frequency must be matched in half.

Table 1: Technical details of solar block.

Open circuit voltage of PV cell, V_{oc}	0.64 V
Open circuit voltage of a module (voc)	23.04V
MPP voltage of PV cell, V_{mpc}	0.5223V
MPP voltage of module (V_{mp})	18.83V
Short circuit current of module (I_{sc})	8.69A
MPP current of module (I_{mp})	8.04A
A Module Power Rating $\mu_{sc} \mu_{Voc}$	151Wp
Pv modules in the solar block	0.04%/oC
String open circuit voltage (SOCV)	-0.36%/oC
	11 strings each are having 9 PV modules
	207.36V

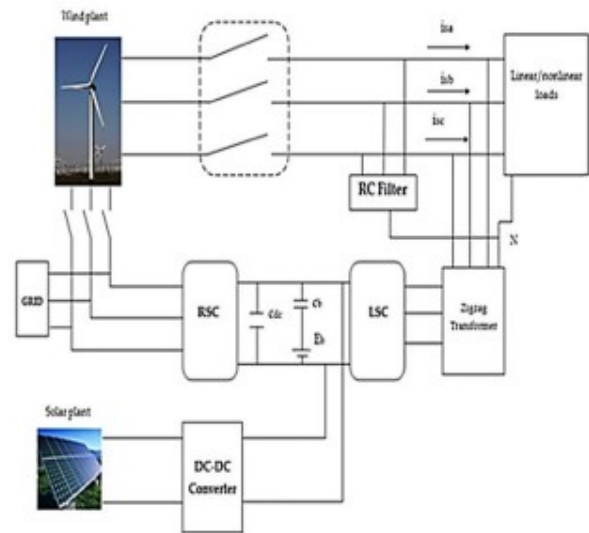


Figure 1: Schematic diagram of a hybrid microgrid of renewable energy sources

3. CONTROL STRATEGY

DC-DC converter with built-in MPPT logic for variable resistance solar converters that harvest energy from the sun. When the solar system is operational, MPPT converts to MPP in an intelligent manner, giving us control. Onshore wind turbines only need to generate energy 60-70% of the time to stay operational when there is no wind. Figure 2 shows the control approach. I^*_{qs} is comprised of two pieces. When the wind machine is operational, the first portion, i_{qs1} , displays the DFIG's current power. i_{qs2} is the second half used when the DFIG stator is not connected to the load terminal. To connect the generator to the filter, you need a particular quantity of reactive power, known as DC I^*_{ds} . If you look at the text below, you'll notice that the I^*_{qs}

microgrid is required. The load receives two kW of linear power and eight kW of nonlinear energy. At $t = 3.25$ seconds, the a-section load will be removed from the community. At $t = 3.46$ s, the b-section load will perform the same. The results show that the tool can provide the most power even when the load is not flat or linear.

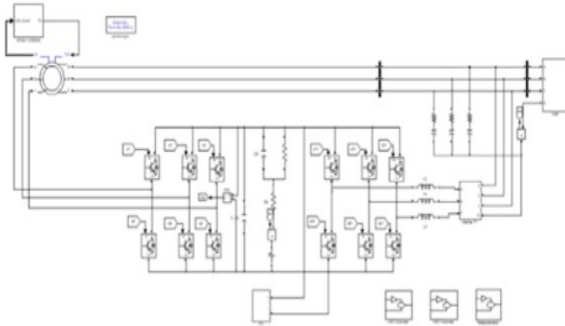


Figure 4: Performance of a system at constant load and cut-in and cut-out of wind power

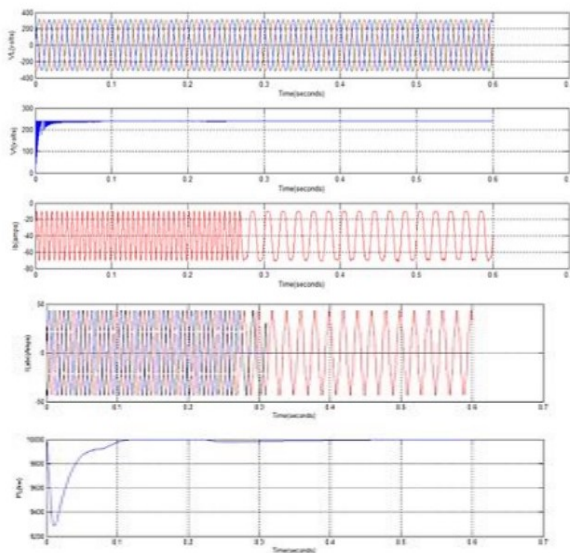


Figure 5: System performance at unbalanced and non-linear load

5. CONCLUSION

The proposed REGS microgrid technology proved to be effective. It is in a remote location and does not require a large amount of home load. REGS, with the use of blocks intended to gather energy from the sun and wind, can provide power while using the most renewable energy possible. The apparatus is designed to function totally on its own. The study also shows the sizes of the key sections. It instructed the system on how to

adjust the input state for various types of load profiles. Regardless of the load terminal state, the power quality remains satisfactory. How dependable is the SIMULINK/MATLAB findings approach.

REFERENCE

1. B. Singh, "Implementation and control of small-scale hybrid standalone power generation system employing wind and solar energy", IEEE on ESC, vol-7, pp.1-7, Sep 2016.
2. H.S. Athab, PV isolated three port converter and energy balancing control method for PV-battery power supply applications, IEEE Indus. Appl. 3 (2015)
3. . M. Das, "Novel high performance standalone solar PV system with high gain, high efficiency
4. DC-DC converter power stages", IEEE Indus. App, 2015
5. . N.A. Orlando, A survey of control issues in PMSG based small wind turbine systems, IEEE Trans Ind. Inf. 9 (3) (2013).
6. T. Hirose, Standalone hybrid wind-solar power generation system applying Dump power control without dump load, IEEE Trans. Ind. Electr. 59 (2) (2012).
7. Q. Zhiyuan, Coordinated control for independent wind-solar hybrid power system, APPEE Conf. (2012).
- A. Singh, "Microgrid: A review", IJRET, vol-3, Issue-2, Feb 2014.
8. M. Lexuan, Review on control of DC microgrids and multiple microgrid clusters, IEEE J. Power Electr. (2017).
9. Y.E.G. Vera, Energy management in microgrids with renewable energy sources: a literature review, APPLSCI (2019).
10. S. Anand, "Renewable integration solar PV and microgrid", Smart Grid Technologies, May 2019.